



AIRIUS MOUNTING GUIDELINES - Q SERIES - Model 50/EC & 50/PS-4

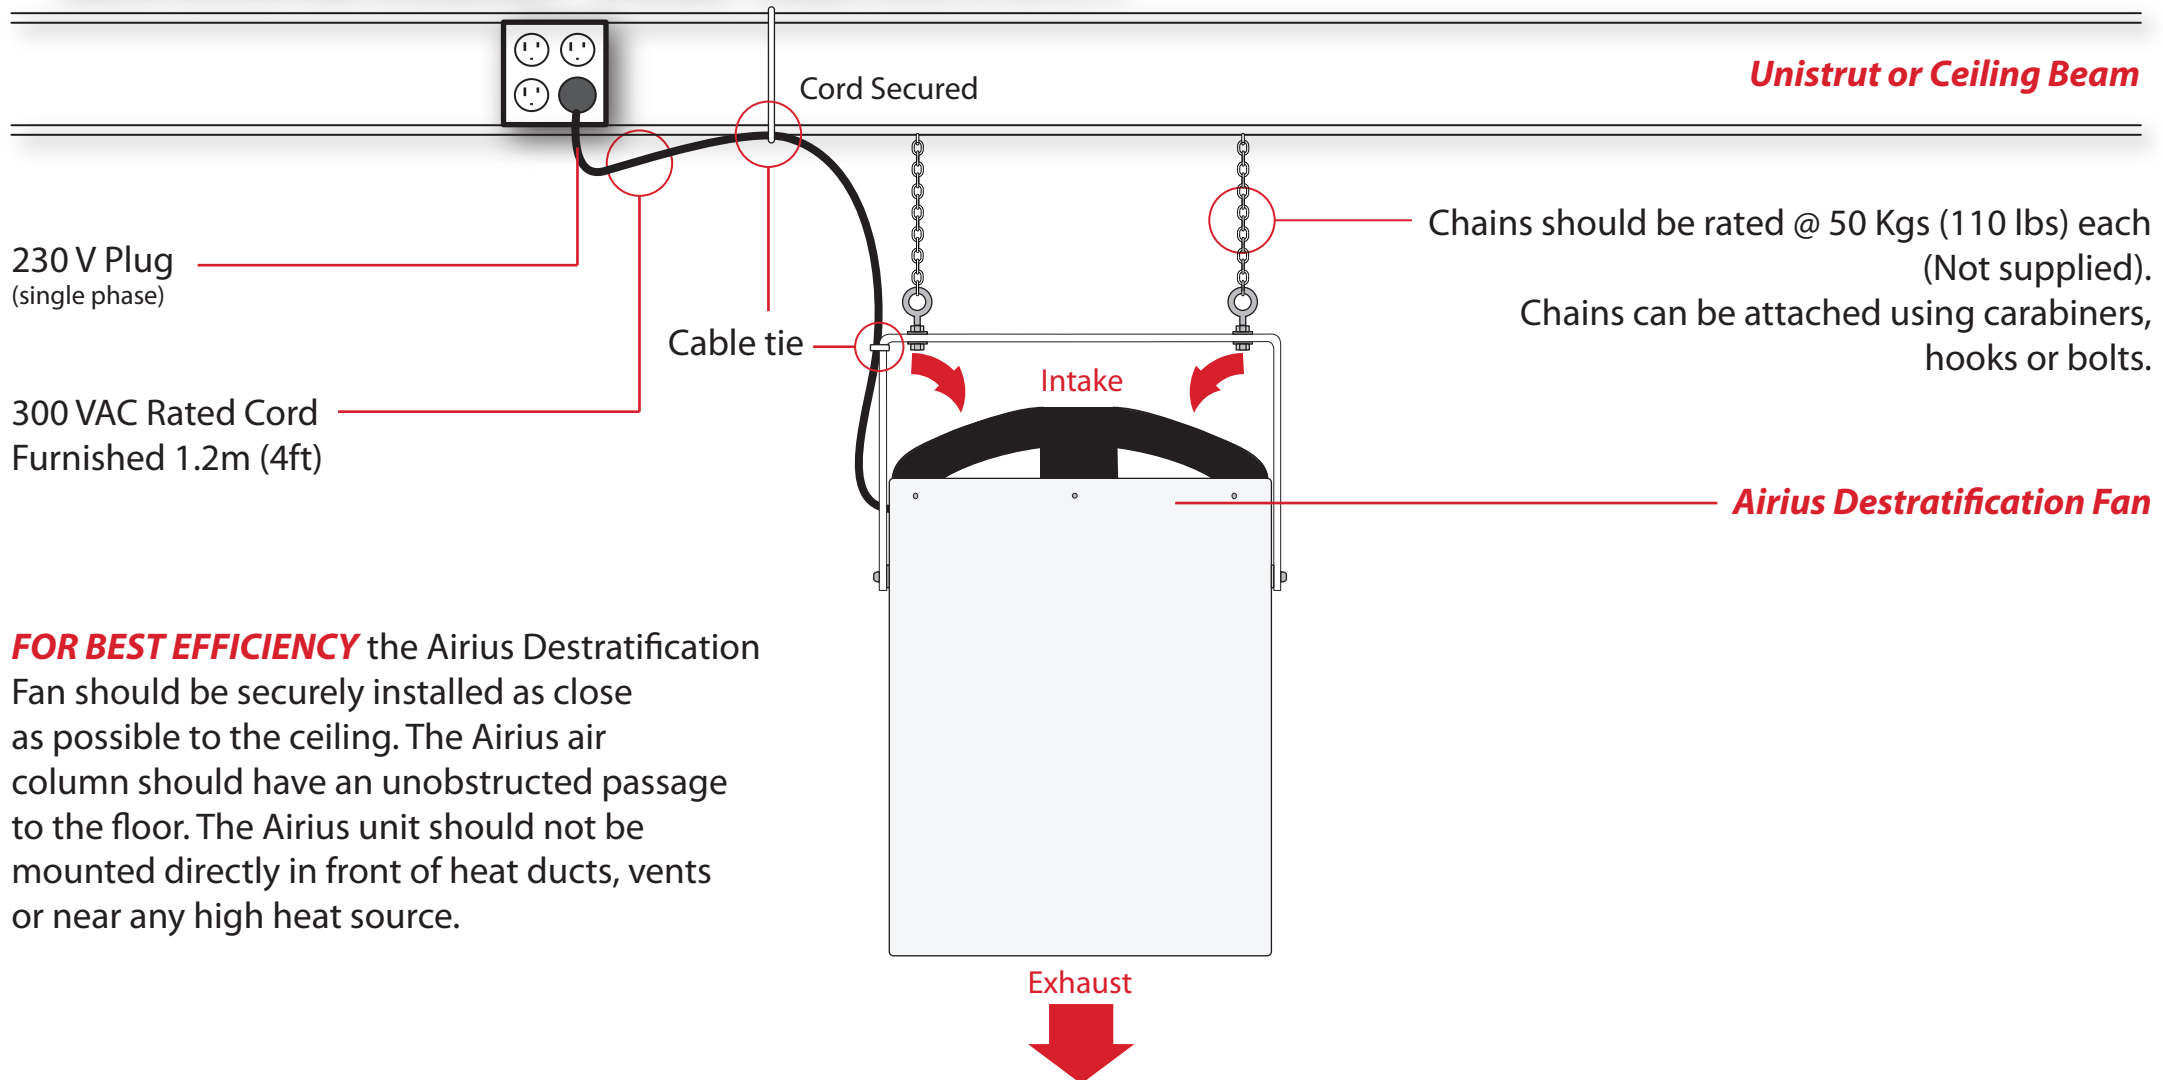

FOR BEST EFFICIENCY the Airius Destratification Fan should be securely installed as close as possible to the ceiling. The Airius air column should have an unobstructed passage to the floor. The Airius unit should not be mounted directly in front of heat ducts, vents or near any high heat source.

AIRIUS MOUNTING GUIDELINES - Q SERIES - Model 50/EC & 50/PS-4

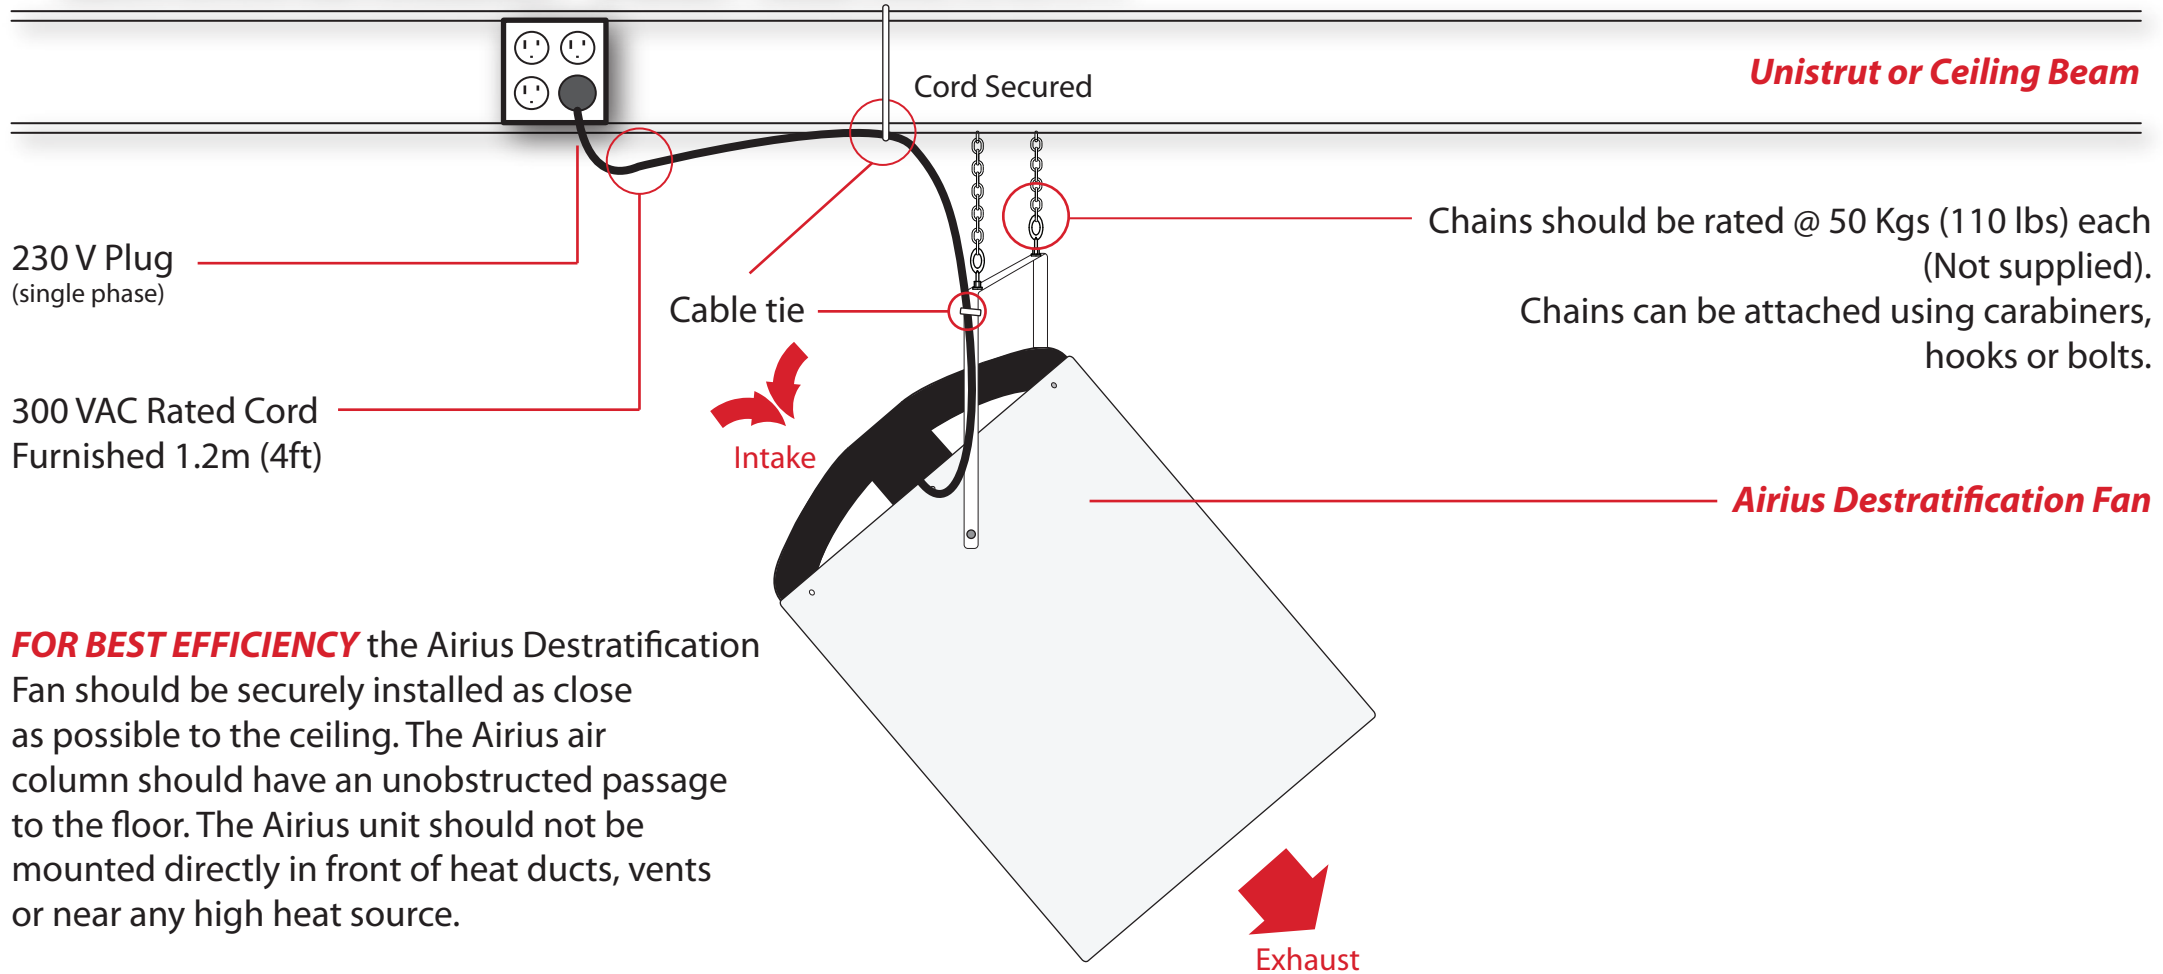

FOR BEST EFFICIENCY the Airius Destratification Fan should be securely installed as close as possible to the ceiling. The Airius air column should have an unobstructed passage to the floor. The Airius unit should not be mounted directly in front of heat ducts, vents or near any high heat source.